


PERMITS & INSPECTIONS

Date: _____
 Applicant/Owner: _____
 Mailing Address: _____
 File no.: _____
 Building Permit no.: _____

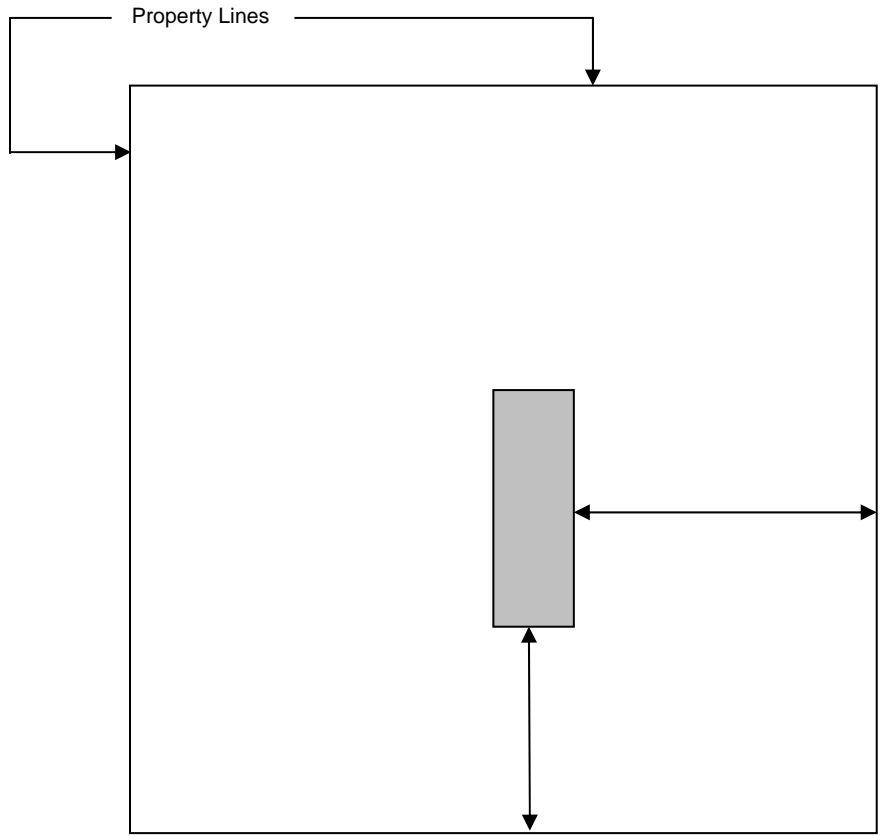

SITE PLAN (Mobile Home)

LABELS: (See Standata 97-IB-003R2)

CSA Label #: _____
 AMA Label #: _____
 Year of Manufacture: _____
 Model / Serial #: _____

Please check off boxes that apply to your mobile home set up and attached this form to your building permit application.

Calgary	25, 2015 - 32 Avenue NE	T2E 6Z3	Ph: 403-717-2344	Fax: 403-717-2340	Toll Free Ph: 1-888-717-2344	Toll Free Fax: 1-888-717-2340
Edmonton	14613 - 134 Avenue	T5L 4S9	Ph: 780-489-4777	Fax: 780-489-4711	Toll Free Ph: 1-866-999-4777	Toll Free Fax: 1-866-999-4711
Grande Prairie	10525 - 100 Avenue	T8V 0V8	Ph: 780-882-8777	Fax: 780-882-7677	Toll Free Ph: 1-877-882-8777	Toll Free Fax: 1-877-882-8775
Lloydminster	Bay 1, 2914 - 50 Avenue	T9V 3B4	Ph: 780-870-9020	Fax: 780-870-9036		
Red Deer	3, 6264 - 67A Street	T4P 3E8	Ph: 403-358-5545	Fax: 403-358-5085	Toll Free Ph: 1-888-358-5545	Toll Free Fax: 1-866-358-5085
Fort McMurray	165, 101 Signal Road	T9H 4N6	Ph: 780-715-7726	Fax: 780-715-7731	Toll Free Ph: 1-877-715-7726	Toll Free Fax: 1-877-715-7731
Lethbridge	422 North Mayor Magrath Drive	T1H 6H7	Ph: 403-320-0734	Fax: 403-320-9969	Toll Free Ph: 1-877-320-0734	

PERMITS & INSPECTIONS

FOUNDATION:

- Concrete Piling as per CSA.
- Wood Blocking as per CSA.
- Concrete Blocking
- Engineered Screw Piling.
(Must be fabricated by CWB certified welder.)
- Building anchorage to be provided where required.
- Foundation as per Part 4 or 9 of the ABC 1997.
- Refer: CSA-Z240.10.1.94
"Site preparation, foundation, & anchorage of mobile homes"
- Others: _____

DECKS/STAIR LANDINGS

- Stairs: Rise: 125 mm to 200 mm (5" to 8")
Run: 210 mm to 355 mm (8¼" to 14")
Tread: 235 mm to 355 mm (9¼" to 14")
- Handrail: 800 mm to 965 mm ht. (32" to 38") required
for exterior stairs with >3 risers.
- Guards: 900 mm ht. (36") required for decks/landings
600 -1,800 mm ht. (2' to 6') above the adjacent grade.
1,070 mm ht. (42") for decks/landing >1,800 mm above
grade.
- Others: _____
- Others: _____

CRAWL SPACE:

- Clearance: 24" between grade & bot. of floor joists
- Ventilation min. 1 ft²/50 ft² of crawl space area.
- Access hatch 500 mm x 700 mm (20" x 28") min.
- Ground shall be graded min 2% for proper drainage.
- Ground cover 0.1 mm poly
- Others: _____
- Others: _____

MOBILE HOME ADDITIONS

ROOF:

- Manufactured Truss @ 600 mm (24") o/c max
- R34 Insulation min. with 6 mil poly V.B. if heated.
- Ceiling 12.5 mm (½") Drywall
- Roll roofing eave protection required (if heated)
- Others: _____
- Others: _____
- Others: _____
- Others: _____

WALL CONSTRUCTION:

- Exterior finished – Vinyl Siding
- ¼" O.S.B. wall sheathing
- 2" x 4" Wall studs @ 600 mm (24") o/c
- R12 Insulation min. with 6 mil poly V.B. if heated
- 12.5 mm (½") Drywall interior finish
- Others: _____
- Others: _____

FLOOR:

- 2" x 10" Joist @ 16" o/c. (provide mid strapping if over 7' in joist span) Others: _____
- 15.5 mm (5/8") thick OSB floor sheathing. Others: _____

FOUNDATION:

- Concrete Piling as per CSA. Others: _____
- Wood Blocking as per CSA.
- Engineered Screw Piling. Must be fabricated by CWB certified welder.
- Foundation as per Part 4 or 9 of the ABC 1997.

EXISTING MOBILE HOMES TO BE RELOCATED ON A NEW SITE:

- Interior walls and ceiling must have surface flame spread rating of 150 or less.
- Walls within 450 mm of range top cooking surface must have at least 9.5 mm GWB.
- Bedrooms must have window with a min, 380 mm opening and a min 0.35 m² in area.
- Furnace room must be covered with at least 7.9 mm thk. Gypsum Wall Board.
- Walls within 150 mm of the HWT must be covered with at least 7.9 mm thk GWB.
- Gas fired HWT must be enclosed in a separate room w/ a door. Room must be supplied with outside air for combustion.